DWG NO 296-300249-024 SHT 1

REVISIONS						
REV	DESCRIPTION	DATE	DWN	CHKR	ENGR	APVD
1	TEMP. REGULATOR VALVE WAS ON RIGHT SIDE OF TANK. DWO 753162	4/28/97	NRM	RCJ	MLJ	KJY
2	101 WAS 15 5/8, 103 WAS 8 5/16		DAP		DAP	

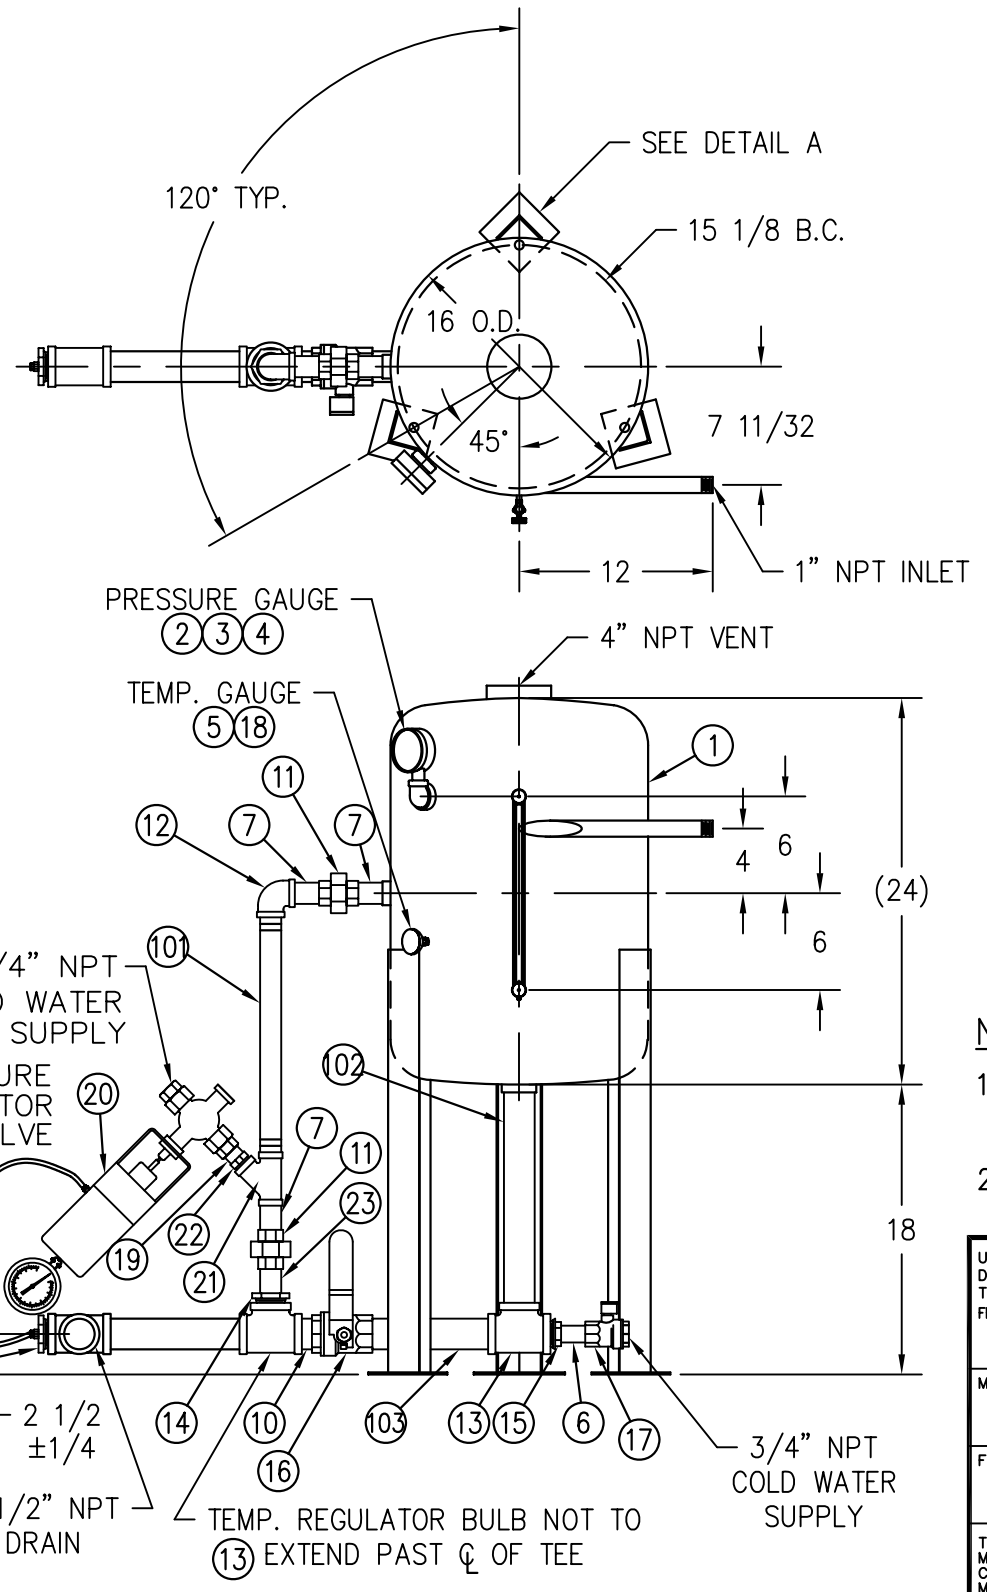

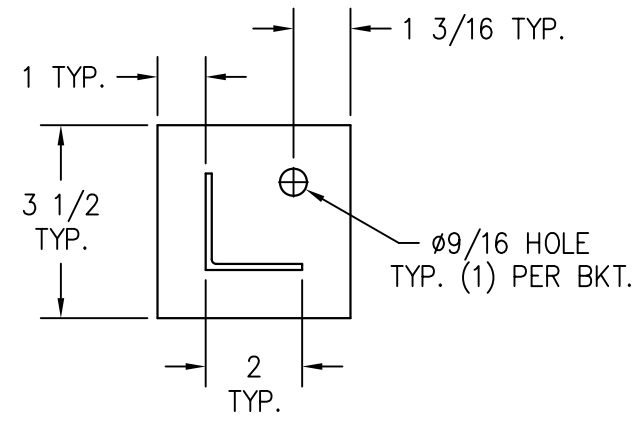

DETAIL "A"
ENLARGED

NOTES:

1. TANK CONSTRUCTED TO ASME CODE SECT. VIII, DIV. I, DESIGN PRESSURE 200 PSI. DESIGN TEMP. 450°F.
2. THREADS TO BE SEALED USING PST #567.

TBE= THREAD BOTH ENDS

PIPE CUT SCHEDULE						
ITEM	QTY	RPO MAT'L	SIZE	SCH	LENGTH	END PREP
101	1	8	1	40	17	TBE
102	1	9	1 1/2	40	14 1/4	TBE
103	1	9	1 1/2	40	8 1/4	TBE
104	1	9	1 1/2	40	9	TBE

UNLESS OTHERWISE SPECIFIED, DIMENSIONS ARE IN INCHES. TOLERANCES ARE:
FRACTIONS ±1/8 DECIMALS .XX ±0.01 .XXX ±0.005 ANGLES ±2°

MATERIALS

FINISH

THIS DRAWING AND THE SUBJECT MATTER SHOWN HEREON IS CONSIDERED CONFIDENTIAL AND MAY BE PROPRIETARY. UNAUTHORIZED DISCLOSURE TO OTHER PARTIES IS EXPRESSLY FORBIDDEN.

CONTRACT NO

USED ON

APPROVALS		DATE
DWN	JTQ	6-26-96
CHKR	RCJ	6-26-96
ENGR	MLJ	6-26-96
APVD	RFS	6-26-96
DWO 749996		PC# 584507
CAD# 886F□90□		

Chromalox® WIEGAND INDUSTRIAL DIV. EMERSON ELECTRIC CO. OGDEN, UTAH 84404 EMERSON

TANK, BLOWDOWN SEPARATOR W/ 0-30 PSI PRESS. GAUGE, 0-200° TEMP GAUGE, AND PIPING

SIZE	CODE IDENT	DRAWING NO	REV
B	07131	296-300249-024	2

SCALE NONE | DO NOT SCALE DRAWING | SHEET 1 OF 1